

EPO 26

Examination Procedure Outline for

Liquefied Petroleum Gas (LPG) Liquid-Measuring Devices

Disclaimer: NIST EPOs are not copyrighted and are free for duplication, reference, or distribution.

It is recommended that this outline be followed for all LPG liquid-measuring devices.

SAFETY NOTES

When excerpting this Examination Procedure Outline for duplication, the EPO Safety Annex (Safety Considerations and Glossary of Safety Key Phrases) should be duplicated and included with this outline.

Prior to beginning any inspection, the inspector should read and be familiar with the EPO Safety Annex - "Safety Considerations and Glossary of Safety Key Phrases." The terms and key phrases in each safety reminder of this outline are found in the glossary the EPO Safety Annex. The inspector is reminded of the importance of evaluating potential safety hazards prior to an inspection and taking adequate precautions to avoid personal injury or damage to the device. As a minimum, the following safety precautions should be noted and followed during the inspection.

Safety policies and regulations vary among jurisdictions. It is essential that inspectors or servicepersons be aware of all safety regulations and policies in place at the inspection site and to practice their employer's safety policies. The safety reminders included in this EPO contain general guidelines useful in alerting inspectors and servicepersons to the importance of taking adequate precautions to avoid personal injury. These guidelines can only be effective in improving safety when coupled with training in hazard recognition and control.

Clothing	Material Safety Data Sheets (MSDS)
Electrical Hazards	Nature of Product
Emergency Procedures	Obstructions and Overhead Hazards
Eye Protection	Personal Protection Equipment
Fire Extinguisher	e.g., Safety Shoes, Safety Aprons, Respirators, Gloves, Barrier Cream, etc., if deemed necessary.
First Aid Kit	Hard Hat -- for protection from overhang in rear of vehicle tank truck
Grounding	Safety Cones/Warning Signs
Ignition Sources	Static Discharge
Lifting	Support -- for prover
Location	Switch Loading
also: Wet/Slick Conditions Chemicals, Petroleum Products, and Hazardous Materials	Traffic
	Transportation of equipment


Inspection:

- SAFETY REMINDER!!!**
- Check the inspection site carefully for safety hazards and take appropriate precautions.
 - Pay particular attention to the condition of the product storage tank and valves.
 - Check to be certain that the ground surface of the inspection site is sufficiently strong and rigid to support the prover when it is filled with product. Don't forget to chock the wheels of the prover.
 - Learn the nature of hazardous products used at or near the inspection site; obtain and read copies of MSDS.
 - Know emergency procedures (particularly for this location) and the location and operation of fire extinguishers and emergency shut-offs.
 - Be sure that a constant supply of water is available for cooling tanks in an emergency.
 - Post safety cones/warning signs and be aware of vehicular and pedestrian traffic patterns.
 - Use caution moving around in wet, slippery areas and in climbing on prover, storage tanks, and vehicles.
 - Use personal protection equipment and clothing appropriate for the inspection site.
 - If exposed wiring or other factors cause hazardous testing conditions, it is recommended that the testing be discontinued until the unsafe conditions are corrected.
 - Be sure that a first aid kit is available and that the kit is appropriate for the type of inspection activity.

**H-44 General Code and
LPG and Anhydrous
Ammonia LMD Code
References**

1. General considerations	
Selection	G-S.3., G UR.1.1., G-UR.1.2., G-UR.1.3.
Use and maintenance	G UR.3.1., G UR.4.1., G-UR.4.2
Installation	G-S.2., G-UR.2.1., G-UR.2.2., UR.1.1.
Accessibility	G UR.2.3
Assistance	G-UR.4.4
Testing devices at a central location	G-UR.4.6.(a).

EPO 26
Liquefied Petroleum Gas Liquid-Measuring Devices

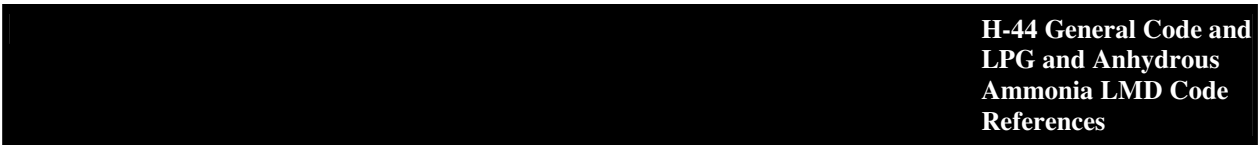

**H-44 General Code and
LPG and Anhydrous
Ammonia LMD Code
References**

Inspection (cont.):

2. Indicating and recording elements.	
Design	S.1.1.
Travel of Indicator, wholesale devices.....	S.1.6.1.
Readability	G-S.5., G-UR.3.3., S.1.2., S.1.3.
Unit Price and Product Identity – Stationary retail devices only.....	S.1.5.1.
Advancement and return to zero, all devices.....	S.1.1.4., UR.2.1.
Indication of delivery, retail devices.....	S.1.4.1.
Return to zero, retail devices.....	S.1.4.2.
Recording element – required for vehicle-mounted systems.....	UR.2.6.
Provision for sealing.....	G-S.8. (1/1/90), G-UR.4.5.
3. Measuring Elements	
Vapor elimination.....	S.2.1., S.2.4.
Security seals.....	G-UR.4.5., S.2.2., Table S.2.2., A.2.6.2.
Thermometer well	S.2.5.
Automatic temperature compensation.....	S.2.6., S.2.6.1., UR.2.4.
4. Marking requirements	G-S.1., G-S.6.(1/1/77), G-S.7., S.4.
Limitation of use.....	S.4.1.
Discharge rate.....	S.4.2.
Location of marking information, retail devices.....	S.4.3.
Temperature compensated volume.....	S.4.4.
5. Discharge line and valves.	
Directional flow valve.....	S.2.3.,
Maintenance of liquid state.....	S.2.4.
Diversion of measured liquid.....	S.3.1.,
Delivery hose.....	S.3.2., UR.1.2.
Fill of discharge.....	UR.2.2.
Vapor-return line.....	UR.2.3
6. Facilitation of fraud.....	G-S.2.

Pretest Determinations:

1. Determine that the test liquid is similar in character to the liquid to be measured commercially..... N.1.
2. Test Drafts. Test drafts shall be equal to at least the amount delivered by the device in 1 minute at its normal discharge rate. N.3.
3. Tolerances
 - Applicable requirements..... G-T., T.1.
 - Tolerance values..... T.2., Table 2
 - Repeatability..... T.3.
 - Automatic temperature-compensating systems T.4.

Test Notes:

SAFETY REMINDER!!!

- **Wear appropriate personal protection equipment such as static-resistant, nonskid safety shoes (to avoid potential ignition source and to prevent possible injury from slipping on slick surfaces), protective clothing, eye protection (to prevent injury from product), and a hard hat (to prevent injury from overhangs and projections on the prover and at the test site).**
- **Use proper grounding procedures!**
- **Be sure that the prover is equipped with an explosion-proof motor.**
- **Carefully inspect the electrical supply lines for the test equipment for wear or damage; correct potentially hazardous conditions before use; protect lines from damage during use.**
- **Remove fire extinguisher(s) from storage receptacle and set out for easy access.**
- **Use proper lifting techniques to lift and move equipment!**
- **Be aware of and attempt to eliminate potential ignition sources in or near the inspection site.**
- **Be aware of vehicular and pedestrian traffic in the area.**

1. Wet the prover (fill to nominal capacity). Allow a 30 second drain period each time the prover is emptied.
2. Exercise care to reduce to a minimum vaporization and volume change..... N.2.
3. Read the temperature and pressure of the product in the prover immediately following each test draft and make appropriate corrections to the test results to account for changes in volume between the meter and the prover due to temperature..... N.5.
4. If the device is equipped with a recording element, print a ticket/receipt after each test run G-S.5.2.2., G-S.5.6., S.1.1.6., UR.2.5.
Vehicle-mounted systems shall be equipped with a ticket printer..... UR.2.6.

EPO 26
Liquefied Petroleum Gas Liquid-Measuring Devices

H-44 General Code and LPG and Anhydrous Ammonia LMD Code References
--

Test Notes (cont.):

- 5. If the device is of the computing type, check price computations..... G-S.5.5., S.1.1.5.,
N.4.3.2.
 Money-value computations on stationary retail devices..... S.1.5.2.
- 6. To determine proper operation of totalizers, observe and record the totalizer indication
 before and after all test drafts.

Test:

Nontemperature-compensated meters

- Read the temperature of the product at the meter at one-third and two-thirds prover
capacity N.5.
- 1. Normal test - full flow, normal tolerance N.2., N.4.1., N.5.,
T.2.
 - 2. Repeat the normal test.
 - 3. Special test - slow flow, special tolerance N.2., N.5., T.2.
 - Motor-fuel devices N.4.1.2.
 - Other retail devices..... N.4.2.2.
 - Wholesale devices N.4.2.3.

If the result of any test is close to or outside the applicable tolerance, repeat that test.


- Repeatability Test N.4.1.2., T.3.
 If necessary, conduct a repeatability test. A repeatability test must include at least
 three consecutive test drafts. Test drafts must be conducted under approximately
 the same conditions (e.g., flow rate and temperature) and be of approximately the
 same draft size.

Temperature-compensated meters

- 1. Normal test - full flow, normal tolerance. (Do not deactivate the temperature N.2., N.4.1., N.4.1.1.,
compensator.)..... N.5., T.2.,
- 2. Deactivate the temperature compensator and repeat the normal test..... N.2., N.4.1.1., N.5., T.2.,
T.4.
- 3. Special test - slow flow, special tolerance..... N.2., N.4.2.1., N.5., T.2.
 - Motor-fuel devices N.4.1.2.
 - Other retail devices..... N.4.2.2.
 - Wholesale devices N.4.2.3.

If the result of any test is close to or outside the applicable tolerance, repeat that test.

EPO 26
Liquefied Petroleum Gas Liquid-Measuring Devices

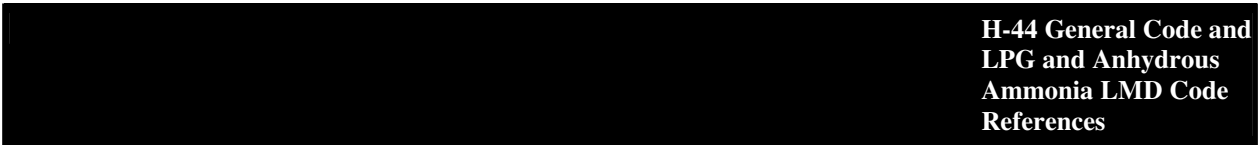

**H-44 General Code and
LPG and Anhydrous
Ammonia LMD Code
References**

Test (cont.):

Repeatability Test N.4.1.2., T.3.

If necessary, conduct a repeatability test. A repeatability test must include at least three consecutive test drafts. Test drafts must be conducted under approximately the same conditions (e.g., flow rate and temperature) and be of approximately the same draft size.

Reactivate the temperature compensator.

Post-Test Tasks:

Security seal and audit trail S.2.2., Table S.2.2.,
S.2.6.2.

- Apply security seals to secure the meter and temperature adjusting mechanisms.
- Also seal the register to the meter.
- Record audit trail information (if applicable) on the official report.

Note the final totalizer reading and record the number of gallons of product dispensed during the test on the official test report.